


R820R1/LEDW25S

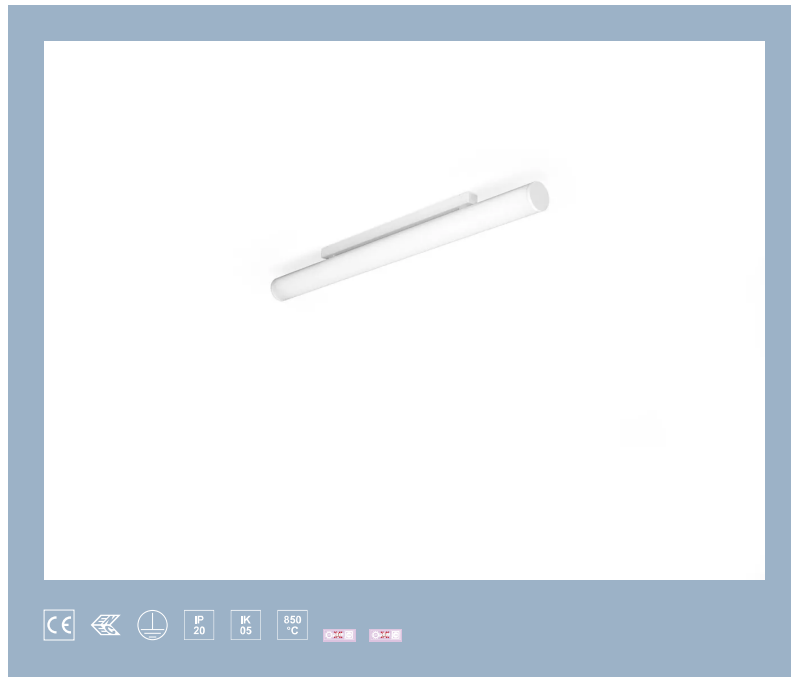

ytmonterad armatur • rektangulär

installation : Allmänna kontorslokaler, Allmänna utbildningslokaler, Allmänna sjukvårdslokaler

ljuskälla : LED • 3000 K

Optik : HaloOptics diffuser • Polykarbonat (PC)
HaloOptics® • bredstrålande

UGR klassificering : <=22

ljusutbyte: 2450 lm

ljusutbyte : 117 lm/W

LLMF: 97% @ 50khrs (Tq=25°C)

Product information

Armatur data

dimensioner : 1162 mm x 80 mm x 121 mm

kulör: RAL9003 - vit (strukturellack)

typ : individuell armatur

IP: IP20

IK: IK05

Elektrisk data

drivenhet: ej dimbar

effekt : 21 W

spänning : 220-240V

frekvens : 50-60Hz AC

fotobiologisk säkerhet : EN 62471: RISK GROUP 0
UNLIMITED

Luminance

ljusflöde : 2450 lm


ljusutbyte : 117 lm/W

UGR klassificering =: <=22

lysande yta : 0.09 m²

Average Luminances (Cd/m²) for 2450lm

Gamma	C0	C30	C45	C60	C90
45°	3463	3455	3473	3598	4800
50°	3313	3287	3286	3366	4576
55°	3190	3139	3099	3138	4337
60°	3071	2993	2933	2922	4059
65°	2969	2874	2785	2717	3760
70°	2882	2765	2663	2542	3426
75°	2792	2675	2560	2396	3008
80°	2733	2614	2479	2279	2520
85°	2663	2546	2411	2205	1769

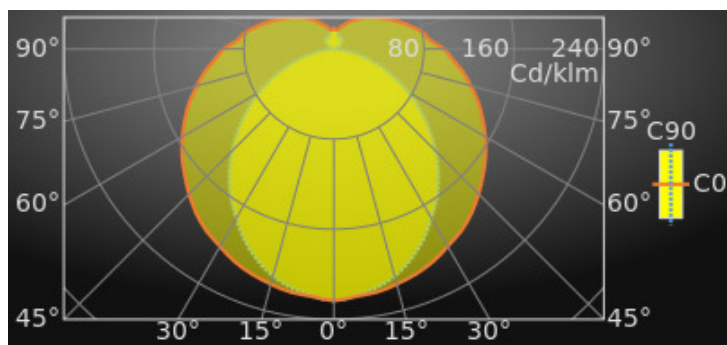

Klassifisering

CIE: 300 / 522 / 679 / 788 / 1000

CIE FLUXCODE : 0.38 / 0.66 / 0.86 / 0.79 / 1.00

BZ: BZ10/1.25/BZ5/1.5/BZ10

CAE: CAE 4/5°/CAE 3/25°/CAE 2/75°/CAE 3

DIN: B30 (Nach Arbeitsblatt 7 und 8)

DIN_U: Phi u = 0.79

DIN_SU: Phi su = 0.45

UTE: 0.79 H + 0.21 T

Lifetime Data (Tq=25.0°C)

Time(khrs)	LLMF(%)	Cx(%)
10	100	2
20	99	4
30	99	6
40	98	8
50	98	10
60	97	12

Ljusstyrka i cd

Intensity for 2450lm

Gamma	C0	C45	C90	Gamma	C0	C45	C90
0°	547.1	547.1	547.1	90°	240.3	156.4	2.9
5°	540.2	539.2	538.9	95°	211.1	135.0	2.7
10°	536.8	532.1	527.6	100°	199.2	125.8	4.4
15°	529.4	520.9	511.5	105°	179.9	113.4	6.8
20°	521.2	505.4	488.0	110°	163.1	102.4	10.0
25°	510.4	484.9	458.8	115°	146.4	92.8	13.4
30°	495.8	462.3	424.8	120°	131.9	84.7	16.7
35°	483.1	437.9	391.5	125°	118.8	77.6	19.3
40°	466.2	410.9	354.6	130°	107.3	71.4	22.6
45°	445.7	382.3	312.8	135°	97.0	65.4	25.8
50°	424.4	354.6	271.1	140°	87.3	60.3	27.6
55°	403.4	325.1	229.2	145°	77.1	56.0	29.0
60°	380.4	296.6	187.0	150°	68.4	51.4	28.5
65°	357.4	268.9	146.4	155°	60.1	47.5	29.2
70°	334.2	242.9	108.0	160°	53.2	43.6	28.4
75°	308.9	218.2	71.7	165°	47.4	40.1	33.6
80°	285.5	194.8	40.3	170°	42.5	39.7	39.1
85°	259.8	172.0	14.2	175°	42.4	42.2	42.6
90°	240.3	156.4	2.9	180°	44.6	44.6	44.6

UGR klassificering =

Corrected Glare Ratings for a Total Lamp Flux of 2450lm (S = 0.25H)

	Room Reflection Factors (%)									
Ceiling	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor	20	20	20	20	20	20	20	20	20	20
Room Dimensions	Viewed Crosswise					Viewed Endwise				
X = 2H Y = 2H	15.7	17.1	16.3	17.8	18.3	14.5	15.9	15.0	16.5	17.1
Y = 3H	17.8	19.1	18.4	19.7	20.3	15.7	17.0	16.3	17.7	18.2
Y = 4H	18.8	20.1	19.4	20.7	21.3	16.2	17.4	16.8	18.1	18.7
Y = 6H	19.8	21.0	20.5	21.6	22.3	16.4	17.6	17.1	18.3	18.9
Y = 8H	20.3	21.4	21.0	22.1	22.7	16.5	17.6	17.2	18.3	18.9
Y = 12H	20.8	21.8	21.4	22.5	23.2	16.5	17.6	17.2	18.3	18.9
X = 4H Y = 2H	16.2	17.5	16.8	18.1	18.7	15.2	16.5	15.9	17.1	17.7
Y = 3H	18.5	19.6	19.2	20.3	20.9	16.7	17.8	17.4	18.5	19.1
Y = 4H	19.7	20.7	20.4	21.4	22.1	17.3	18.3	18.0	19.0	19.7
Y = 6H	20.9	21.8	21.6	22.5	23.2	17.8	18.7	18.5	19.4	20.1
Y = 8H	21.5	22.3	22.2	23.1	23.8	17.9	18.7	18.6	19.5	20.2
Y = 12H	22.1	22.8	22.8	23.6	24.3	17.9	18.7	18.7	19.5	20.2
X = 8H Y = 4H	20.0	20.8	20.7	21.6	22.3	18.0	18.8	18.7	19.6	20.3
Y = 6H	21.5	22.2	22.2	22.9	23.6	18.7	19.4	19.5	20.2	20.9
Y = 8H	22.2	22.8	23.0	23.6	24.3	19.0	19.6	19.8	20.4	21.1
Y = 12H	23.0	23.5	23.7	24.3	25.1	19.2	19.7	20.0	20.5	21.3
X = 12H Y = 4H	20.0	20.8	20.7	21.5	22.2	18.1	18.9	18.9	19.7	20.4
Y = 6H	21.5	22.2	22.3	22.9	23.7	19.0	19.6	19.8	20.4	21.2
Y = 8H	22.4	22.9	23.1	23.7	24.5	19.4	20.0	20.2	20.8	21.5
	UGR Variations with Observer Position for Luminaire Spacings S									
S = 1.0H	+0.1		-0.1			+0.1		-0.1		
S = 1.5H	+0.2		-0.2			+0.1		-0.2		
S = 2.0H	+0.2		-0.3			+0.3		-0.4		

Colour properties

Correlated Colour Temperature : 3000

Ra: CRI (Ra) 80

Verkningsgrad

Utilisation Factors according to IES (%)										
	Room Reflection Factors (%)									
Ceiling	80	80	80	50	50	50	30	30	30	0
Walls	50	30	10	50	30	10	50	30	10	0
Floor	20	20	20	20	20	20	20	20	20	0
RCR = 1	94	90	88	81	79	77	74	72	70	60
2	81	75	70	69	65	62	63	59	56	48
3	70	63	58	60	55	51	55	50	47	39
4	62	54	48	53	47	43	48	43	39	33
5	55	47	41	48	41	37	43	38	34	28
6	50	41	35	43	36	32	39	34	29	24
7	45	36	31	39	32	28	36	30	26	22
8	41	33	27	36	29	25	33	27	23	19
9	37	29	24	33	26	22	30	25	21	17
10	34	27	22	30	24	20	28	22	19	15

Utilisation Factors according to LiTG (%)										
	Room Reflection Factors (%)									
Ceiling	80	80	80	50	50	50	50	50	30	0
Walls	50	30	50	30	50	30	50	30	30	0
Floor	30	30	10	10	30	30	10	10	10	0
k = 0.60	41	32	39	31	36	29	35	28	26	19
0.80	51	41	48	39	44	37	42	36	33	25
1.00	59	49	55	46	51	43	48	42	39	30
1.25	67	57	62	54	58	51	55	49	45	36
1.50	74	64	67	59	63	56	59	54	50	40
2.00	82	73	74	67	70	64	65	60	56	46
2.50	89	80	79	72	76	70	70	65	61	51
3.00	94	86	82	77	80	74	74	69	65	54
4.00	100	93	86	82	84	80	77	74	68	58
5.00	104	98	89	85	88	84	80	77	72	61

Måttskiss

