


D42R1/LEDW1820S

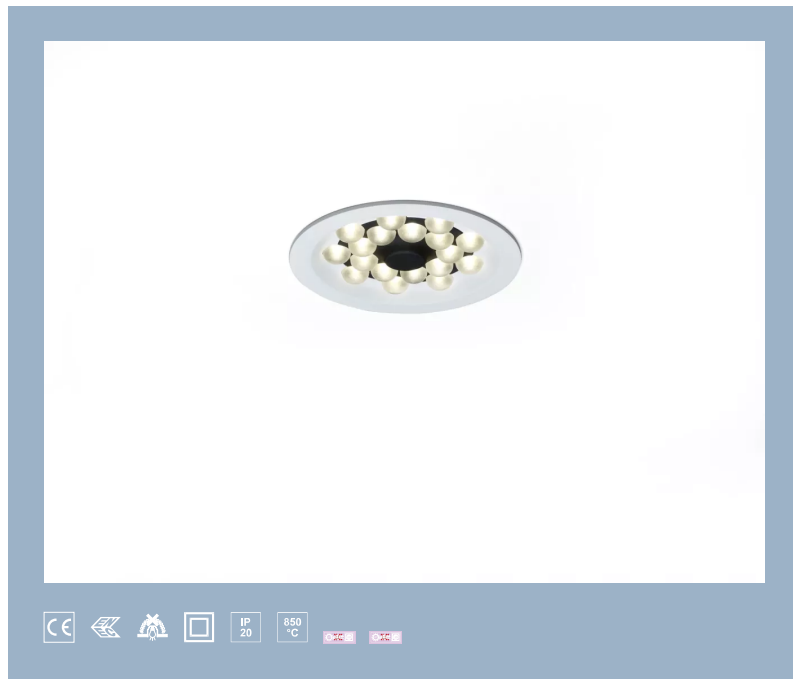

infällda armatur • cirkulär

installation : Allmänna kontorslokaler, Allmänna utbildningslokaler

armaturhus: lackerat aluminium

ljuskälla : LED • 3000 K

Optik : LED+LENS™ • Polycarbonate (PC) lens • bredstrålände

UGR klassificering : <=22

ljusutbyte: 2100 lm

ljusutbyte : 124 lm/W

LLMF: 98% @ 50khrs (Tq=25°C)

Product information

Armatur data

dimensioner : 200 mm x 70 mm

håltagning : 180 mm x 70 mm

kulör: RAL9003 - vit

ring: låg ring

typ : individuell armatur

IP: IP20

Elektrisk data

drivenhet: ej dimbar

effekt : 17 W

spänning : 220-240V

frekvens : 50-60Hz AC

fotobiologisk säkerhet : EN 62471: RISK GROUP 1 UNLIMITED

current : 12 A

Luminance

ljusflöde : 2100 lm

ljusutbyte : 124 lm/W


luminans @ 65° = : 3000 cd/m²

UGR klassificering =: <=22

lysande yta : 0.02 m²

Average Luminances (Cd/m²) for 2100lm

Gamma	C0	C30	C45	C60	C90
45°	25653	25653	25653	25653	25653
50°	11031	11031	11031	11031	11031
55°	5537	5537	5537	5537	5537
60°	3481	3481	3481	3481	3481
65°	2653	2653	2653	2653	2653
70°	2250	2250	2250	2250	2250
75°	1956	1956	1956	1956	1956
80°	1681	1681	1681	1681	1681
85°	1324	1324	1324	1324	1324

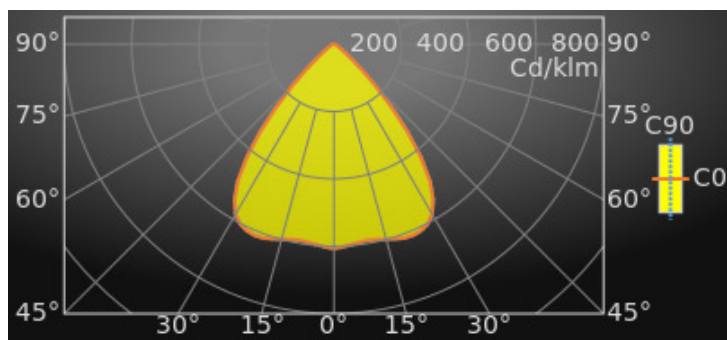

Klassifisering

CIE: 835 / 982 / 997 / 1000 / 1000

CIE FLUXCODE : 0.84 / 0.98 / 1.00 / 1.00 / 1.00

BZ: BZ1

CAE: Symmetrical

DIN: A60 (Nach Arbeitsblatt 7)

DIN_U: Phi u = 1.00

DIN_SU: Phi su = 0.76

UTE: 1.00 B + 0.00 T

Lifetime Data (Tq=25.0°C)

Time(khrs)	LLMF(%)	Cx(%)
10	100	2
20	99	4
30	99	6
40	99	8
50	98	10
60	98	12

Ljusstyrka i cd

Intensity for 2100lm

Gamma	C0	C45	C90
0°	1273.9	1273.9	1273.9
5°	1254.1	1254.1	1254.1
10°	1240.8	1240.8	1240.8
15°	1257.9	1257.9	1257.9
20°	1285.5	1285.5	1285.5
25°	1283.5	1283.5	1283.5
30°	1223.4	1223.4	1223.4
35°	1044.4	1044.4	1044.4
40°	717.0	717.0	717.0
45°	364.7	364.7	364.7
50°	142.6	142.6	142.6
55°	63.9	63.9	63.9
60°	35.0	35.0	35.0
65°	22.5	22.5	22.5
70°	15.5	15.5	15.5
75°	10.2	10.2	10.2
80°	5.9	5.9	5.9
85°	2.3	2.3	2.3
90°	0.7	0.7	0.7

UGR klassificering =

Corrected Glare Ratings for a Total Lamp Flux of 2100lm (S = 0.25H)

	Room Reflection Factors (%)									
Ceiling	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor	20	20	20	20	20	20	20	20	20	20
Room Dimensions	Viewed Crosswise					Viewed Endwise				
X = 2H Y = 2H	20.1	21.6	20.4	21.9	22.1	20.1	21.6	20.4	21.9	22.1
Y = 3H	20.0	21.4	20.3	21.6	21.9	20.0	21.4	20.3	21.6	21.9
Y = 4H	20.0	21.2	20.3	21.5	21.8	20.0	21.2	20.3	21.5	21.8
Y = 6H	19.9	21.0	20.3	21.3	21.7	19.9	21.0	20.3	21.3	21.7
Y = 8H	19.9	21.0	20.3	21.3	21.6	19.9	21.0	20.3	21.3	21.6
Y = 12H	19.9	20.9	20.2	21.2	21.5	19.9	20.9	20.2	21.2	21.5
X = 4H Y = 2H	19.9	21.2	20.3	21.5	21.8	19.9	21.2	20.3	21.5	21.8
Y = 3H	19.9	20.9	20.2	21.2	21.6	19.9	20.9	20.2	21.2	21.6
Y = 4H	19.8	20.7	20.2	21.1	21.4	19.8	20.7	20.2	21.1	21.4
Y = 6H	19.8	20.6	20.2	21.0	21.4	19.8	20.6	20.2	21.0	21.4
Y = 8H	19.8	20.5	20.2	20.9	21.3	19.8	20.5	20.2	20.9	21.3
Y = 12H	19.7	20.4	20.2	20.8	21.3	19.7	20.4	20.2	20.8	21.3
X = 8H Y = 4H	19.7	20.5	20.2	20.9	21.3	19.7	20.5	20.2	20.9	21.3
Y = 6H	19.7	20.3	20.2	20.8	21.2	19.7	20.3	20.2	20.8	21.2
Y = 8H	19.7	20.2	20.2	20.7	21.2	19.7	20.2	20.2	20.7	21.2
Y = 12H	19.7	20.2	20.2	20.6	21.2	19.7	20.2	20.2	20.6	21.2
X = 12H Y = 4H	19.7	20.4	20.2	20.8	21.2	19.7	20.4	20.2	20.8	21.2
Y = 6H	19.7	20.2	20.2	20.7	21.2	19.7	20.2	20.2	20.7	21.2
Y = 8H	19.7	20.1	20.2	20.6	21.1	19.7	20.1	20.2	20.6	21.1
	UGR Variations with Observer Position for Luminaire Spacings S									
S = 1.0H	+2.8		-6.6			+2.8		-6.6		
S = 1.5H	+5.1		-8.2			+5.1		-8.2		
S = 2.0H	+7.1		-8.9			+7.1		-8.9		

Colour properties

Correlated Colour Temperature : 3000

Ra: CRI (Ra) 80

Verkningsgrad

Utilisation Factors according to IES (%)										
	Room Reflection Factors (%)									
Ceiling	80	80	80	50	50	50	30	30	30	0
Walls	50	30	10	50	30	10	50	30	10	0
Floor	20	20	20	20	20	20	20	20	20	0
RCR = 1	109	107	106	103	101	100	99	98	97	92
2	100	96	94	95	92	90	92	89	88	83
3	91	87	83	87	83	81	85	81	79	75
4	84	78	74	80	76	73	78	74	72	68
5	77	71	67	74	69	66	72	68	65	62
6	71	65	60	69	63	60	67	62	59	56
7	66	59	55	64	58	54	62	57	54	52
8	61	55	50	59	54	50	58	53	49	47
9	57	50	46	55	50	46	54	49	45	43
10	53	47	42	52	46	42	51	45	42	40

Utilisation Factors according to LiTG (%)										
	Room Reflection Factors (%)									
Ceiling	80	80	80	50	50	50	50	50	30	0
Walls	50	30	50	30	50	30	50	30	30	0
Floor	30	30	10	10	30	30	10	10	10	0
k = 0.60	65	58	62	56	63	57	61	56	55	50
0.80	77	70	72	67	74	68	71	66	66	61
1.00	85	77	79	73	81	75	77	72	72	67
1.25	94	88	86	82	90	84	84	81	80	76
1.50	99	93	90	86	94	89	88	85	84	80
2.00	106	100	95	91	99	95	92	90	89	85
2.50	111	106	98	95	103	99	95	93	92	88
3.00	115	110	100	98	106	103	98	96	95	91
4.00	118	114	102	100	108	106	99	98	96	93
5.00	121	117	103	102	110	108	100	99	98	94

Måttskiss

